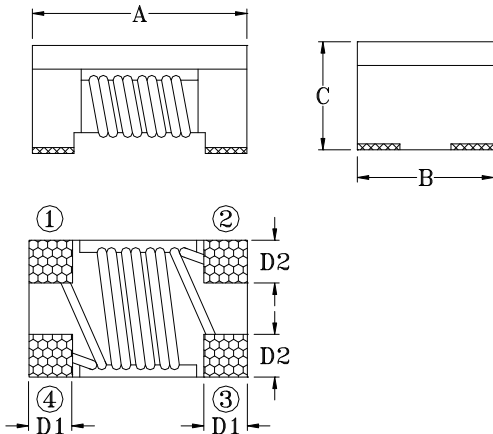


SPECIFICATION FOR APPROVAL

COMMODITY	COMMON MODE FILTER CHOKE	SPEC NO.	SP-0181005001
ITEM	JACM 3225V-110	Green	版本：A 表單編號：QR-012-02

(1) DIMENSION: (UNIT: mm)		DIM.	TOL.
	A	3.30	±0.20
	B	2.50	±0.20
	C	2.50	Max.
	D1	0.55	±0.15
	D2	0.75	±0.20

(2) ELECTRICAL CHARACTERISTIC			TEST INSTRUMENTS.
Common mode Impedance	300 (min)	Ω	☒ AGILENT 4294A Precision Impedance Analyzer. ☐ AGILENT 4285A Precision L.C.R. Meter. ☐ HP-4286A RF L.C.R. Meter. ☒ ZENTECH 3302 Automatic Components Analyzer. ☐ ZENTECH 101 L.C.R. Meter. ☐ WAYNE KERR 6420 Precision Impedance Analyzer. ☒ ZENTECH 1320 BIAS CURRENT. ☒ ZENTECH 502AC Resistance Merter. ☐ ADEX AX-1155B DC Low Ohm Meter.
Test Frequency	500 (typ.)		
	10	MHz	
Inductance	11 +50 %	μH	
Test Frequency	100	KHz	
Test Volt	0.1	V	
	-30 %		
RDC	0.4 (max)	Ω	
Rated Current	300 (max)	mA	
Rated Volt.	80	Vdc	
Insulation Resistance	10 (min)	MΩ	

REMARK :


1. Operating temperature range : - 55℃ to + 150℃ (Including self temp. rise)
2. Storage temperature and Humidity range : -55~+150℃ (on board)
3. Compatible with AEC-Q200

PURCHASER CONFIRMED	APPROVED	CHECKED	DRAWN
			

TEST REPORT

SPEC NO : SP-0181005001

Typical Impedance v.s. Frequency Curve

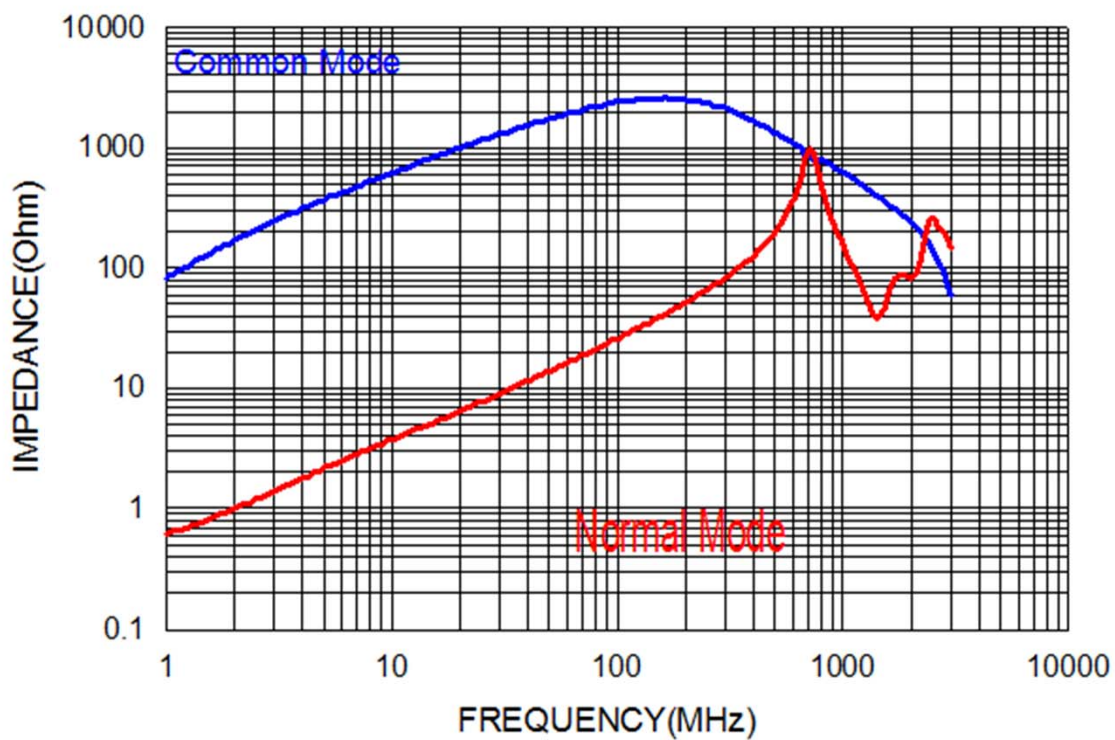

Check by :



Test by :



TEL : 886-2-2689-4971 FAX : 886-2-2689-4260
E-mail : jantek@jantek-elec.com.tw
Web-Site : www.jantek-elec.com.tw