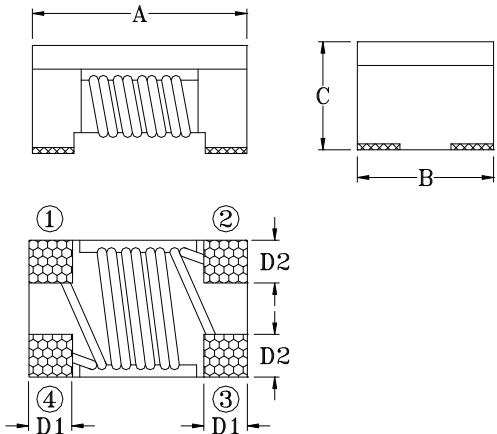


SPECIFICATION FOR APPROVAL

COMMODITY	COMMON MODE FILTER CHOKE	SPEC NO.	SP-0181005004
ITEM	JACM 3225V-510	Green	版本：A 表單編號：QR-012-02

(1) DIMENSION: (UNIT: mm)		DIM.	TOL.
	A	3.30	±0.20
	B	2.50	±0.20
	C	2.50	Max.
	D1	0.55	±0.15
	D2	0.75	±0.20

(2) ELECTRICAL CHARACTERISTIC		TEST INSTRUMENTS.
Common mode Impedance	1000 (min) Ω 2600 (typ.)	☒ AGILENT 4294A Precision Impedance Analyzer.
Test Frequency	10 MHz	☐ AGILENT 4285A Precision L.C.R. Meter.
Inductance	51 +50 % -30 % μH	☐ HP-4286A RF L.C.R. Meter.
Test Frequency	100 KHz	☒ ZENTECH 3302 Automatic Components Analyzer.
Test Volt	0.1 V	☐ ZENTECH 101 L.C.R. Meter.
RDC	0.7 (max) Ω	☐ WAYNE KERR 6420 Precision Impedance Analyzer.
Rated Current	200 (max) mA	☒ ZENTECH 1320 BIAS CURRENT.
Rated Volt.	80 Vdc	☒ ZENTECH 502AC Resistance Merter.
Insulation Resistance	10 (min) MΩ	☐ ADEX AX-1155B DC Low Ohm Meter.

REMARK :


1. Operating temperature range : - 55℃ to + 150℃ (Including self temp. rise)
2. Storage temperature and Humidity range : -55~+150℃ (on board)
3. Compatible with AEC-Q200

PURCHASER CONFIRMED	APPROVED	CHECKED	DRAWN
			

TEST REPORT

SPEC NO : SP-0181005004

Typical Impedance v.s. Frequency Curve

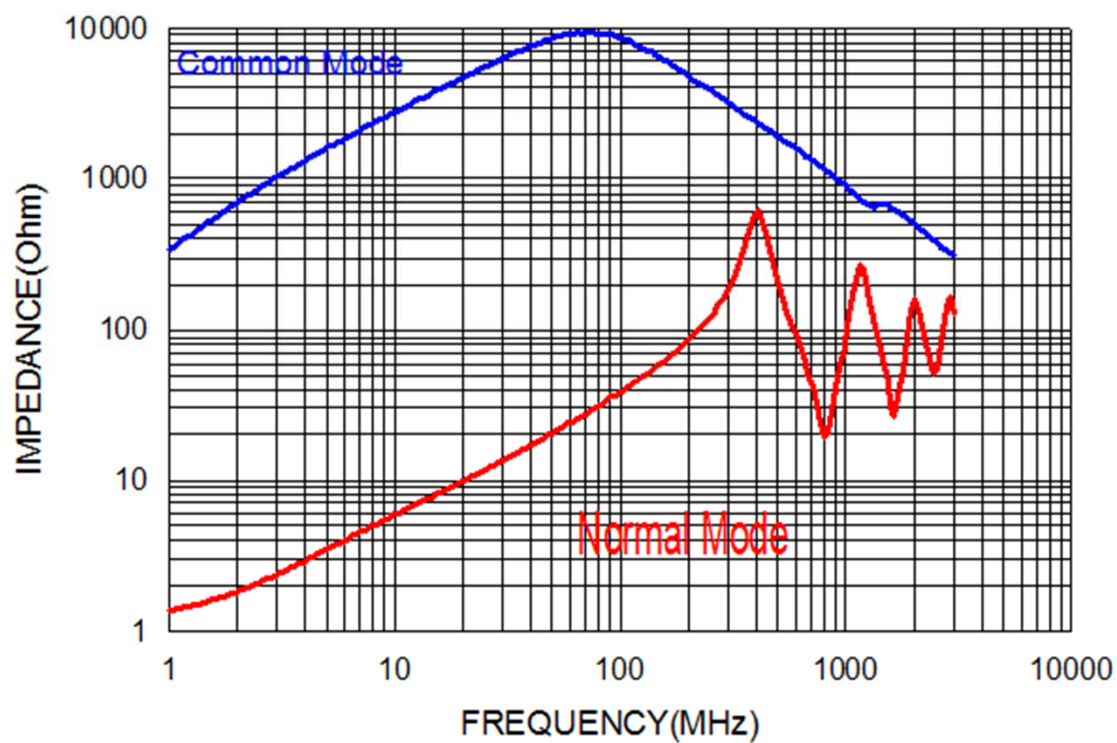

Check by :



Test by :



TEL : 886-2-2689-4971 FAX : 886-2-2689-4260
E-mail : jantek@jantek-elec.com.tw
Web-Site : www.jantek-elec.com.tw