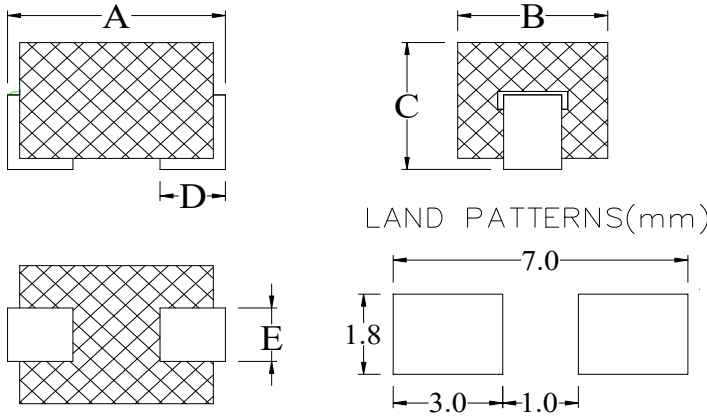


SPECIFICATION FOR APPROVAL

COMMODITY	S.M BEAD	SPEC NO.	SP-N240920021
ITEM	SMB 403025-530 Green	版本：A	表單編號：QR-012-02

(1) DIMENSION: (UNIT: mm)		DIM.	TOL.	
	A	4.70	±0.40	
	B	3.10	±0.15	
	C	2.90	±0.20	
	D	1.35	±0.20	
	E	1.25	±0.05	

(2) ELECTRICAL CHARACTERISTIC			TEST INSTRUMENTS.
IMPEDANCE at Z1	35 ± 25%	Ω	<input checked="" type="checkbox"/> AGILENT 4294A Precision Impedance Analyzer
IMPEDANCE at Z2	53 ± 25%	Ω	<input checked="" type="checkbox"/> Agilent 4287A RF LCR Meter <input type="checkbox"/> AGILENT 4285A Precision L.C.R. <input type="checkbox"/> HP-4286A RF L.C.R. Meter.
TEST FREQUENCY at Z1	25	MHz	<input checked="" type="checkbox"/> CHROMA 3302 Automatic Components Analyzer.
TEST FREQUENCY at Z2	100	MHz	<input type="checkbox"/> WAYNE KERR 6420 Precision Impedance Analyzer.
RDC	0.6 (max)	mΩ	<input checked="" type="checkbox"/> ZENTECH 1320 BIAS CURRENT. <input checked="" type="checkbox"/> BK PRECISION 2840 DC Resistance Meter
RATED CURRENT (ΔT=40°C)	15 (typ.)	A	<input type="checkbox"/> ZENTECH 502AC Resistance Merter <input type="checkbox"/> ADEX AX-1155B DC Low Ohm Meter
RATED CURRENT (ΔT=60°C)	18 (typ.)	A	<input type="checkbox"/> WAYNE KERR HI-POT TESTER 7600


REMARK :

PURCHASER CONFIRMED :	APPROVED	CHECKED	DRAWN
			

TEST REPORT

SPEC NO : SP-N240920021

Typical Impedance v.s. Frequency Curve

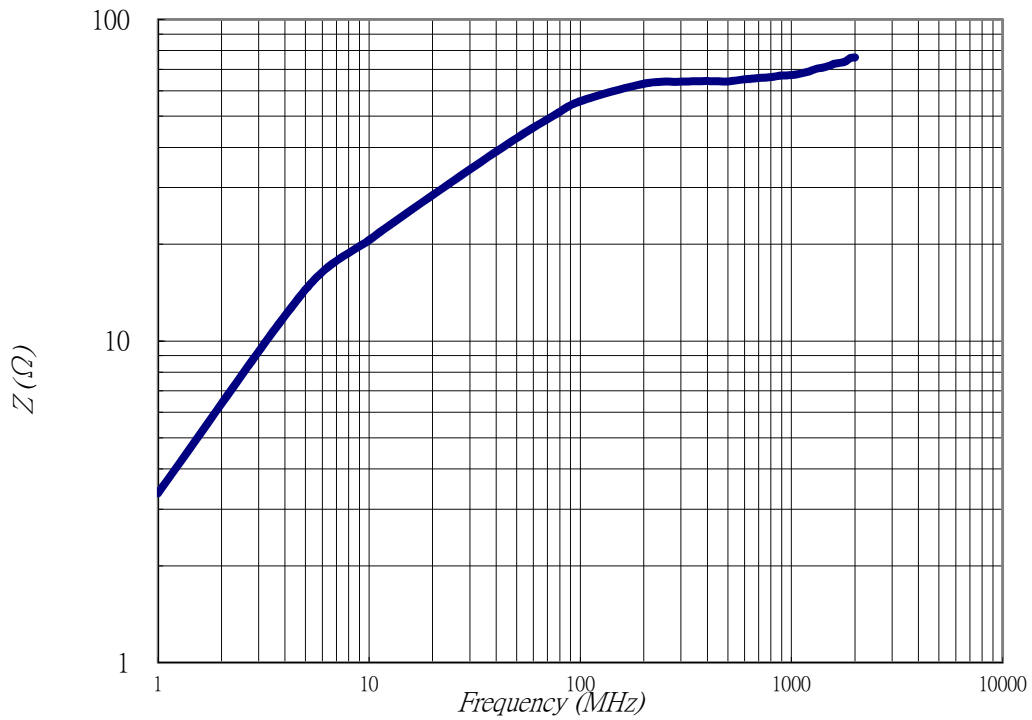

Test Instrument :

HP-4287A RF L.C.R. Meter.

Testing Condition :

Temperature : 25 to 28°C

Humidity : 60 to 70 % RH

Check by :

姜秀琴

Test by :

陳秀月