

SPECIFICATION FOR APPROVAL

COMMODITY	S.M BEAD		SPEC NO.	SP-N250513001
ITEM	SMB 322521I	Green	版本：A	表單編號：QR-012-02

(1) DIMENSION: (UNIT: mm)		DIM.	TOL.	
<p style="text-align: center;">LAND PATTERNS(mm)</p>	A	3.10	±0.15	
	B	2.50	±0.15	
	C	2.15	±0.15	
	D	0.80	±0.20	
	E	0.80	±0.10	

(2) ELECTRICAL CHARACTERISTIC			TEST INSTRUMENTS.
IMPEDANCE at Z 1	25 ± 25%	Ω	<input checked="" type="checkbox"/> AGILENT 4294A Precision Impedance Analyzer
IMPEDANCE at Z 2	35 ± 25%	Ω	<input checked="" type="checkbox"/> Agilent 4287A RF LCR Meter
TEST FREQUENCY at Z 1	25	MHz	<input type="checkbox"/> AGILENT 4285A Precision L.C.R.
TEST FREQUENCY at Z 2	100	MHz	<input type="checkbox"/> HP-4286A RF L.C.R. Meter.
RDC	0.6 (max)	mΩ	<input checked="" type="checkbox"/> CHROMA 3302 Automatic Components Analyzer.
IDC	21 (typ.)	A	<input type="checkbox"/> WAYNE KERR 6420 Precision Impedance Analyzer.
			<input checked="" type="checkbox"/> ZENTECH 1320 BIAS CURRENT.
			<input checked="" type="checkbox"/> BK PRECISION 2840 DC Resistance Meter
			<input type="checkbox"/> ZENTECH 502AC Resistance Merter
			<input type="checkbox"/> ADEX AX-1155B DC Low Ohm Meter
			<input type="checkbox"/> WAYNE KERR HI-POT TESTER 7600

REMARK :


- . Rated Current :Chroma high current test fixure.
- . ΔT = 40°C rise typ at IDC.

PURCHASER CONFIRMED :	APPROVED	CHECKED	DRAWN

TEST REPORT

SPEC NO : SP-N250513001

Typical Impedance v.s. Frequency Curve

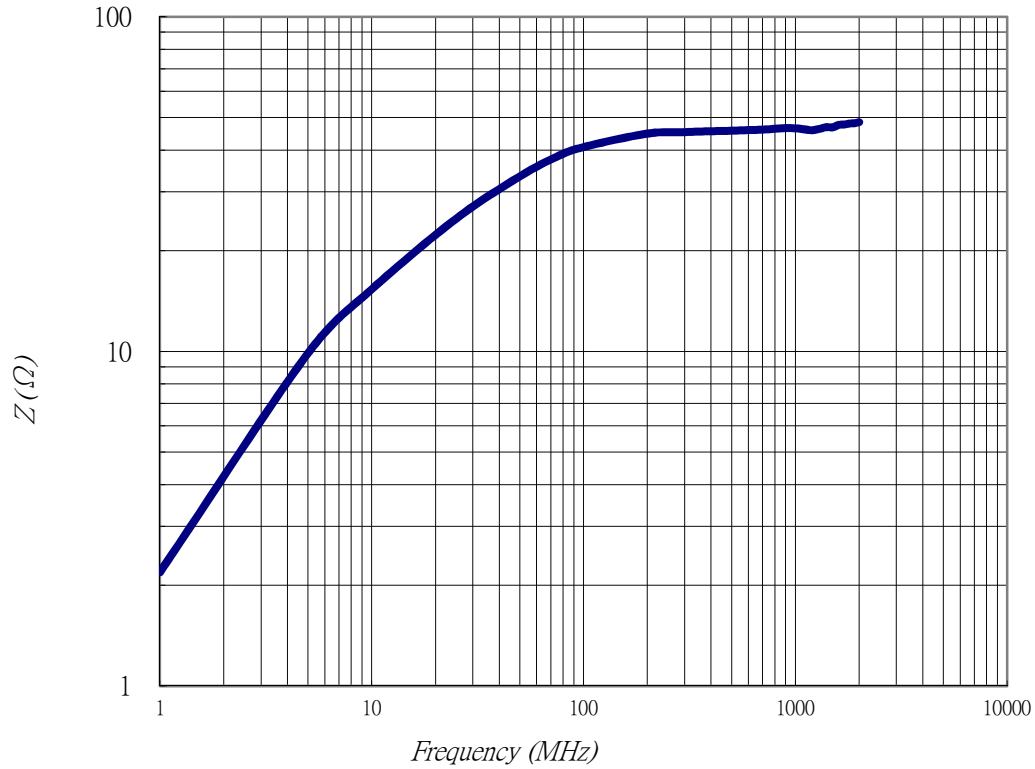

Test Instrument :

Agilent 4287A RF LCR Meter

Testing Condition :

Temperature : 25 to 28°C

Check by :



Test by :



TEL : 886-2-2689-4971 FAX : 886-2-2689-4260

E-mail : jantek@jantek-elec.com.tw

Web-Site : www.jantek-elec.com.tw